


ASYA14LCC Capacity/Input data


(1/2)

Heating

< Capacity >

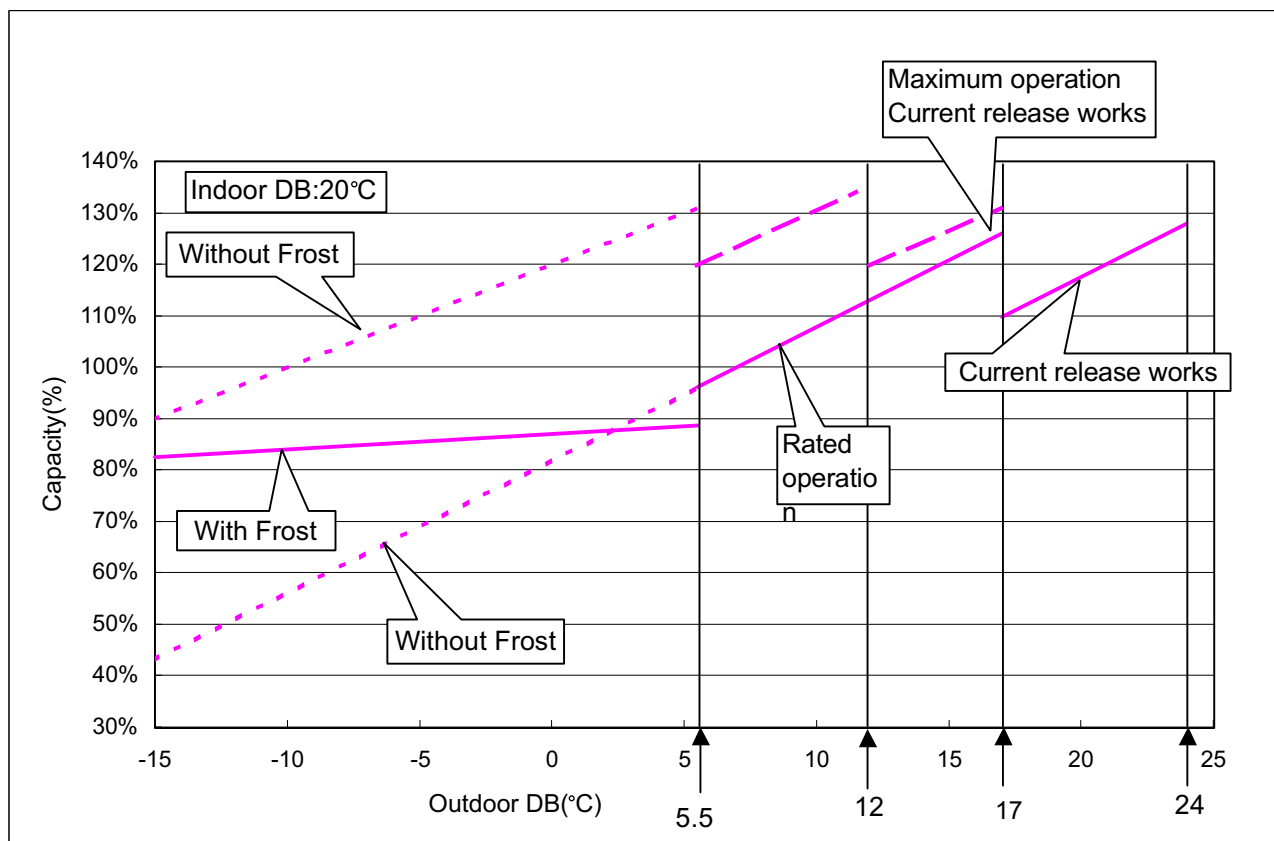

< Input >

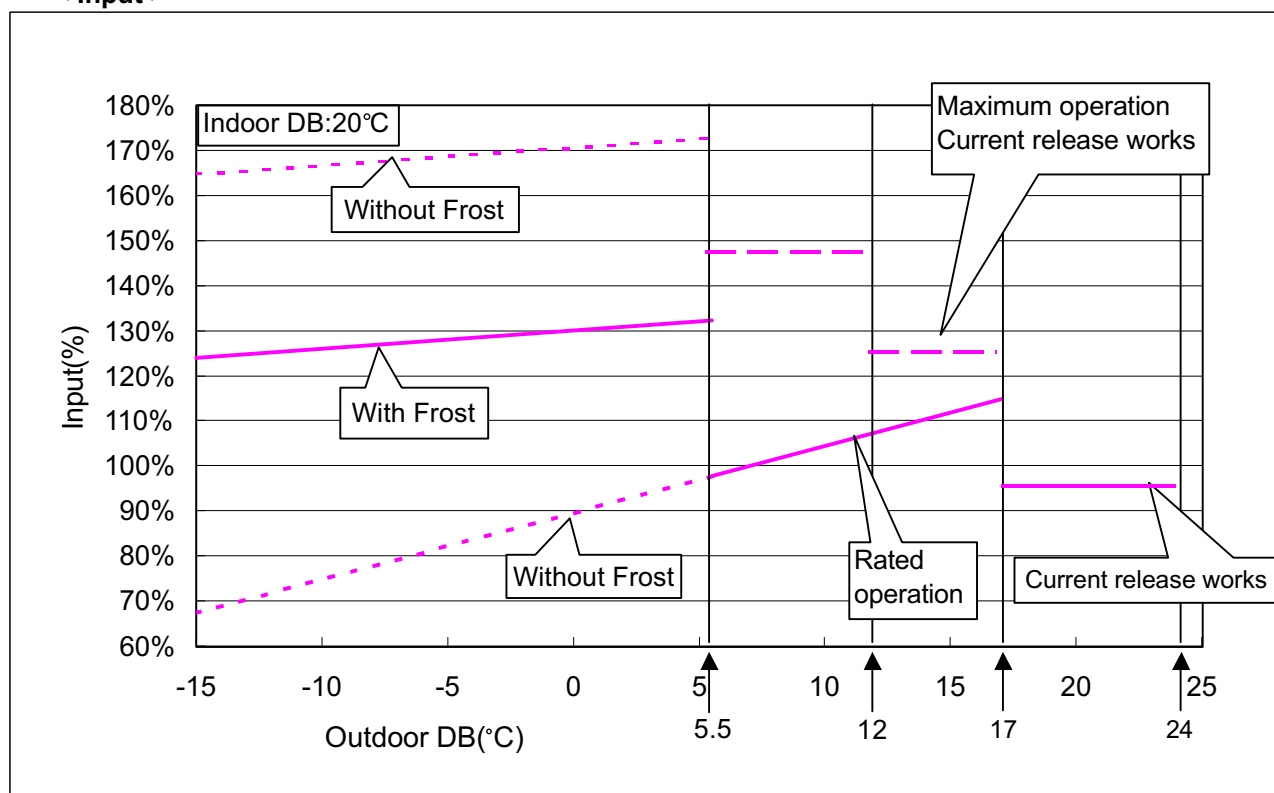

*Defrosting operation is performed when temperature is less than 5.5 degrees C.

Frost appears on an outdoor unit heat exchanger at 5.5 or less degrees C.

*Solid line: Integral capacity/Input containing the defrosting cycle.

*Dotted line: Capacity/Input which does not contain the defrosting cycle.